


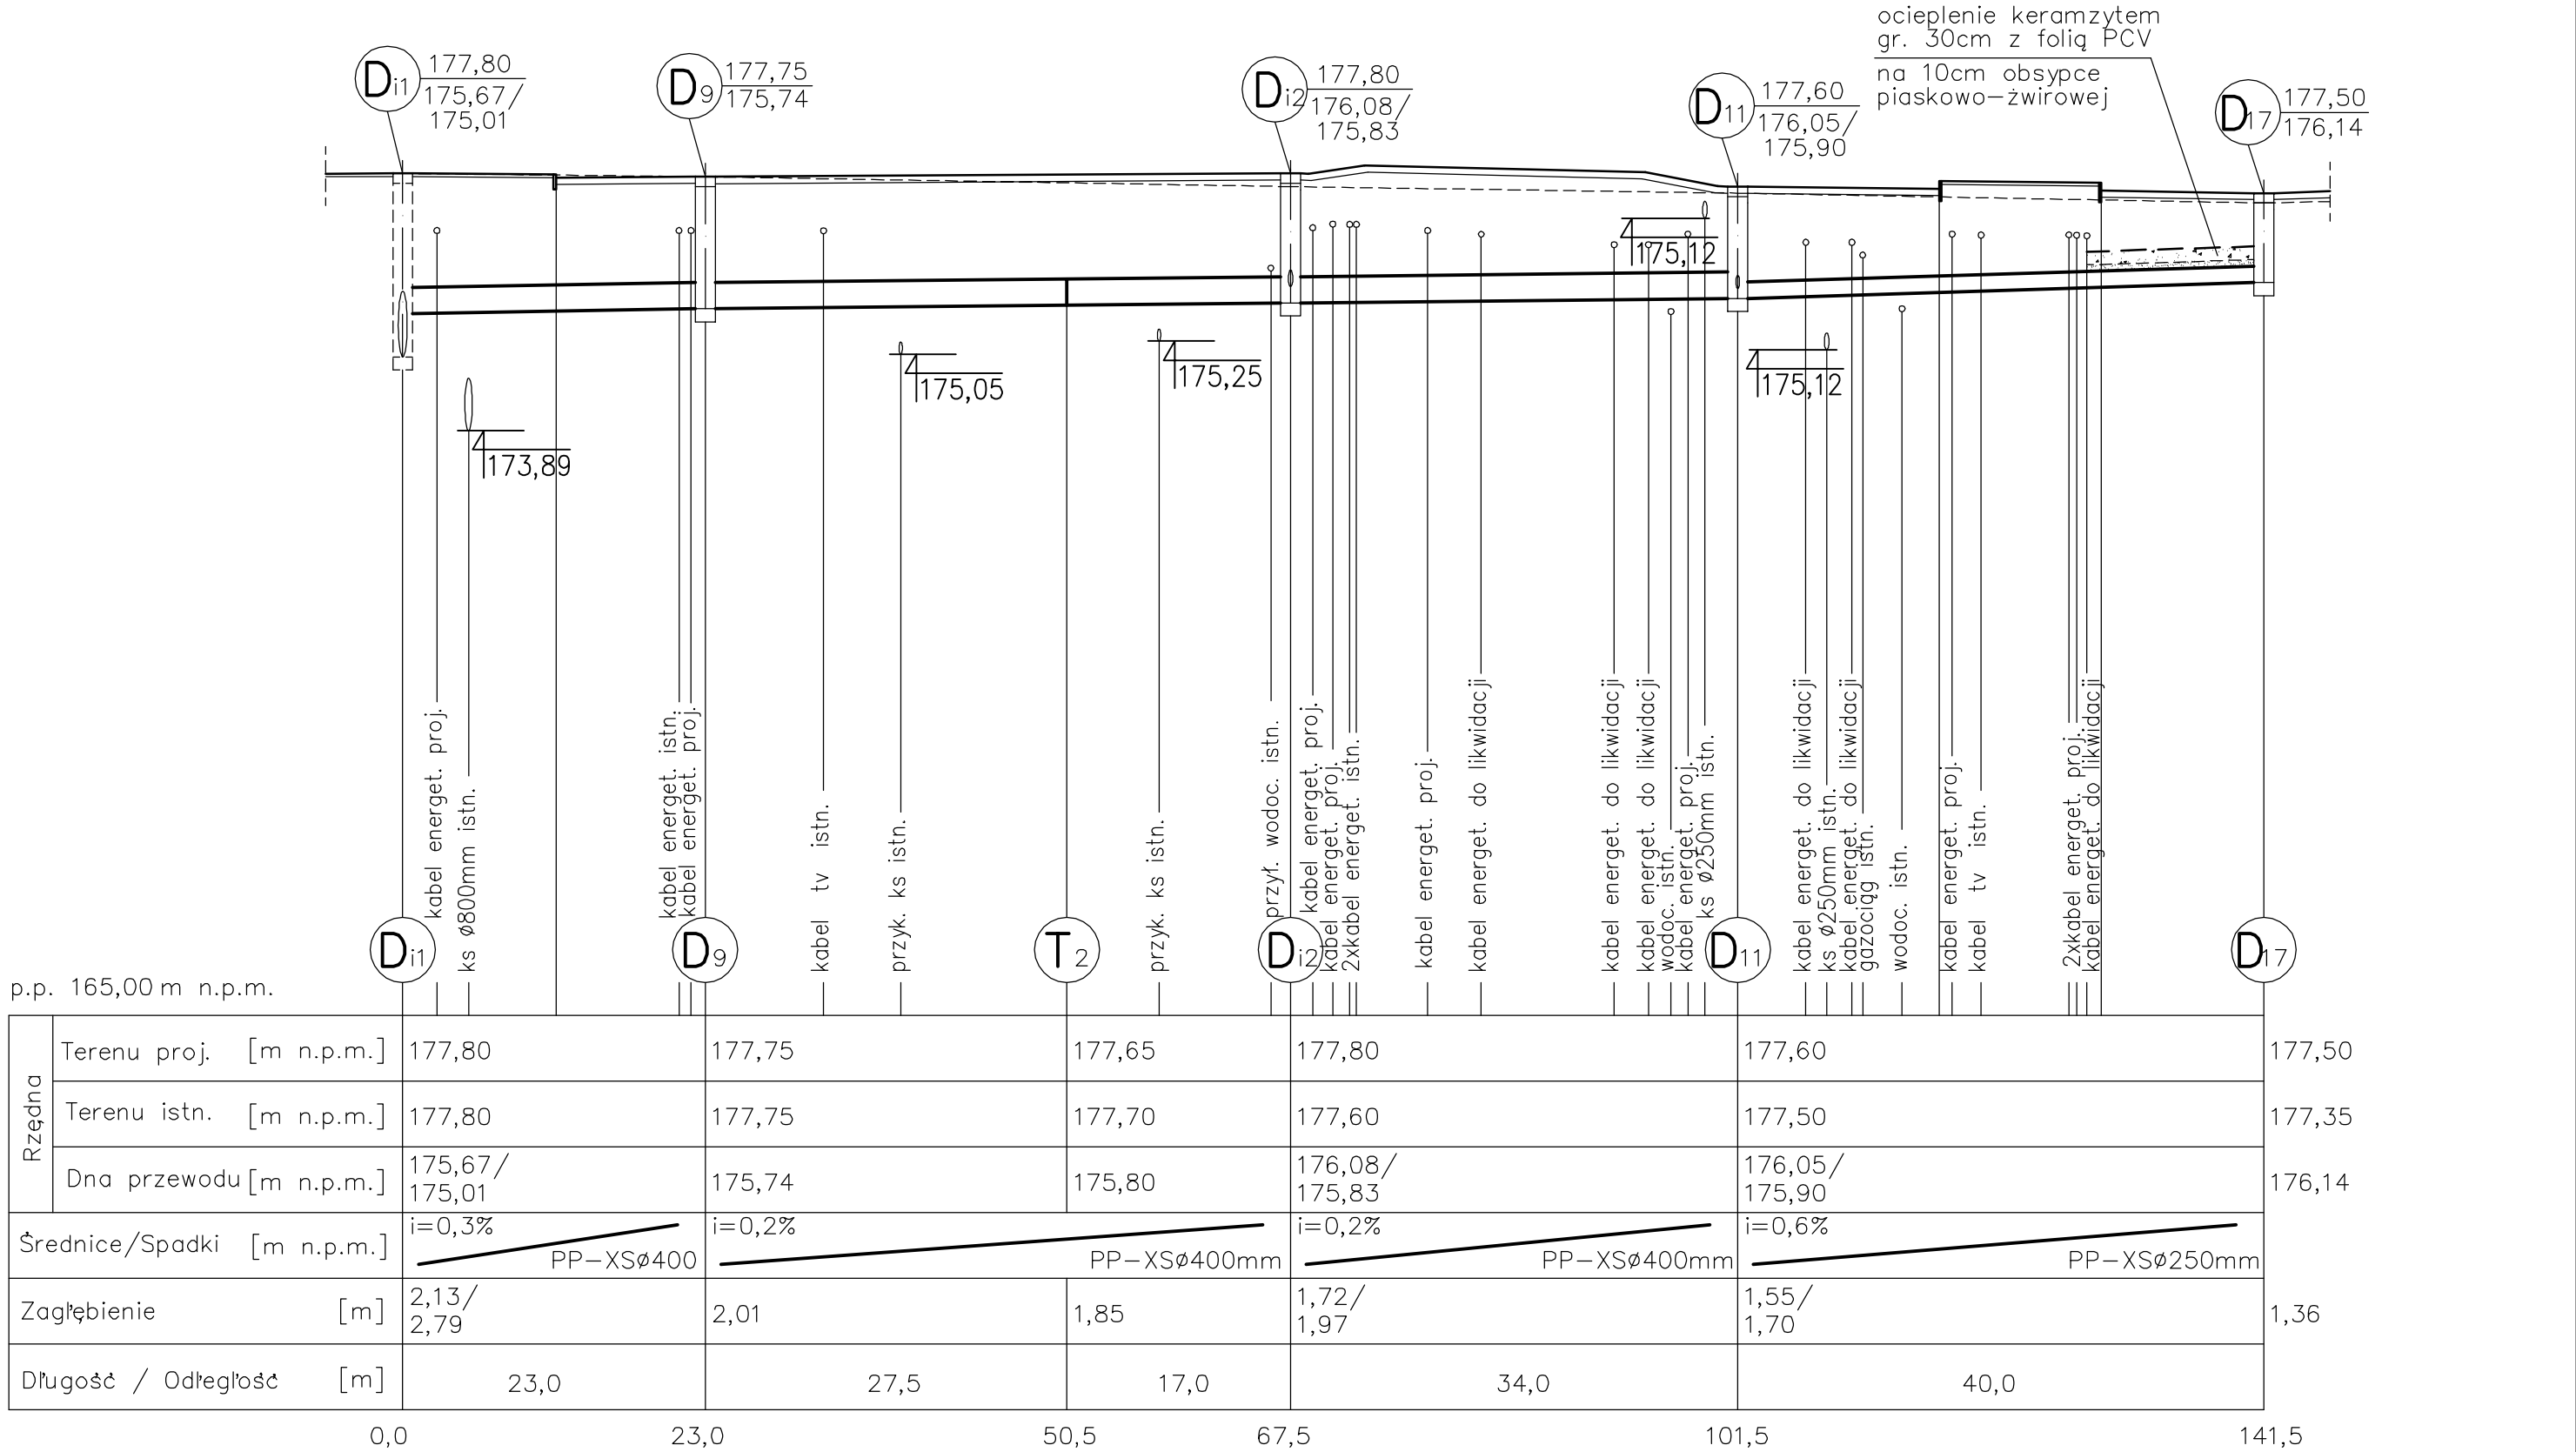

p.p. 165,00 m n.p.m.

Rzędna	Terenu proj. [m n.p.m.]	177,80	177,75	177,65	177,80	177,60	177,50
	Terenu istn. [m n.p.m.]	177,80	177,75	177,70	177,60	177,50	177,35
	Dna przewodu [m n.p.m.]	175,67/ 175,01	175,74	175,80	176,08/ 175,83	176,05/ 175,90	176,14
Średnice/Spadki [m n.p.m.]	i=0,3%  PP-XSø400		i=0,2%  PP-XSø400mm		i=0,2%  PP-XSø400mm		i=0,6%  PP-XSø250mm
Zagłębienie [m]	2,13/ 2,79	2,01	1,85	1,72/ 1,97	1,55/ 1,70	1,36	
Długość / Odległość [m]	23,0	27,5	17,0	34,0	40,0		

0,0 23,0 50,5 67,5 101,5 141,5

PROJEKTOWANIE I NADZORY RENATA STANKIEWICZ 16-400 SUWAŁKI, UL. ELCKA 23			
OBIEKT ADRES	ROZBUDOWA ULICY MŁYNARSKIEGO W SUWAŁKACH		ETAP I
data: .07.2014r	PROJEKTANT	SPRAWDZAJĄCY	
Imię i nazwisko nr uprawnień	mgr inż. DOROTA BAZYLEWICZ PDL/0075/PWOS/05	mgr inż. ANDRZEJ URBANOWICZ SUW-1/96	
TYTUŁ RYSUNKU	KANALIZACJA DESZCZOWA Ciąg kanalizacyjny do Di1. Profil podłużny.		SKALA 1:100/500 RYS. NR KD4